

Module, with delayed contacts at the opening of the input channels, for emergency stop, gate monitoring, solid state output devices and magnetic safety sensor

#### Main functions

- For safety applications up to SIL 3 / PL e
- Single or dual channel input circuit
- Choice between automatic start, manual start or monitored start
- Connection of the input channels to opposite potentials
- Connectible to solid-state output circuits (for example optical barriers), to electromechanical contacts or to magnetic safety sensor
- 45 mm housing
- 2 NO safety instantaneous contacts, 1 NC auxiliary instantaneous contact, 2 NO safety delayed contacts.
- Supply voltages: 24 Vac/dc, 120 Vac, 230 Vac

**Utilization categories** 

Alternate current: AC15 (50...60 Hz) Ue (V) 230 le (A) 3 Direct current: DC13 (6 operations/minute) Ue (V) le (A)

# Markings, quality marks and certificates:





Approval UL: E131787

# Complying with the requirements requested by:

Low Voltage Directive 2006/95/EC, Machinery Directive 2006/42/EC,

Electromagnetic Compatibility 2004/108/EC

#### **Technical data**

# Housing

Made of polyamide PA 6.6 self-extinguishing, class V0 (UL94)

IP40 (housing), IP20 (terminals) Protection degree: Dimensions: see page 5/82, shape C

### General data

SIL level (SIL CL): up to SIL 3 according to EN IEC 62061 Performance Level (PL): up to PL e according to EN ISO 13849-1 Safety category: up to category 4 (instantaneous contacts)

category 3 (delayed contacts) according to EN 954-1

230 Vac; 50...60 Hz

Safety parameters: see page 7/32 Ambient temperature: -25°C...+55°C >10 millions of operations Mechanical endurance:

Electrical endurance: >100.000 operations Pollution degree: outside 3, inside 2 Rated impulse with stand voltage (Uimp): 4 KV

Rated insulation voltage (Ui): 250 V Over-voltage category: Ш 0,5 Kg Weight:

#### Power supply

24 Vac/dc; 50...60 Hz Rated operating voltage (Un): 120 Vac; 50...60 Hz

Max residual ripple in DC: 10% Supply voltage tolerance: ±15% of Un Rated power consumption AC: < 10 VA Rated power consumption DC: < 5 W

#### **Control circuit**

Protection against short circuits: resistance PTC, Ih=0,5 A

Operating time of PTC: intervention > 100 ms, reset > 3 s

Max input resistance: ≤ 50 Ω 30 mA Current for each input: Min. period of start impulse  $t_{MIN}$ : 200 ms Operating time  $t_A$ : 150 ms Releasing time  $t_{R1}^{A}$ : Releasing time in absence of power supply  $t_{a}$ : 20 ms 150 ms

see "CODE STRUCTURE" Releasing time delayed contacts t<sub>R2</sub>:

Simultaneity time t<sub>c</sub>: infinite

# In conformity with standards:

IEC 60947-1, EN 60947-5-1, IEC 60204-1, EN 60204-1, EN ISO 13849-1, EN 999, EN 1037, EN ISO 12100-1, EN ISO 12100-2, EN ISO 13850, IEC 529, EN 60529, EN 61000-6-2, EN 61000-6-3, EN 62326-1, EN 60664-1, EN 60947-5-1, EN 62061, EN 13849-1, UL 508, CSA C22.2 n° 14-95

**Output circuit** Output contacts: 2 NO safety instantaneous contacts, 1 NC auxiliary instantaneous contact,

2 NO safety delayed contacts. Contacts type: forced guided contacts Contacts material: silver alloy, gold plated Max switching voltage: 230/240 Vac; 300 Vdc

Max switching current per contact: 6 A Conventional free air thermal current lth:

Max currents sum  $\Sigma$  Ith<sup>2</sup>: 72 (instantaneous cont.), 36 (delayed cont.) A<sup>2</sup>

Min. current: 10 mA ≤ 100 mΩ Contacts resistance: Contact protection fuse: 6 A, F type

The number and the load capacity of output contacts can be increased by using expansion modules or contactors See page See page 5/49 - 5/58 and 5/79

#### **Code structure**

# CS AT-00V024-TF1

# Releasing time delayed contacts (t<sub>R2</sub>)

- Fixed time (see TF)
- from 0,3 to 3 s, step 0,3 s
- from 1 to 10 s, step 1 s
- from 3 to 30 s, step 3 s
- 4 from 30 to 300 s, step 30 s

#### Kind of connection

- V screw terminals
- connector with screw terminals
- **X** connector with spring terminals

# Releasing time delayed contacts (t<sub>R2</sub>)

**TF0.5** fixed 0,5 s

**TF1** fixed 1 s

TF3 fixed 3 s

Supply voltage

024 24 Vac/dc +15% **120** 120 Vac ±15%

230 Vac

±15%

# Data type approved by UL

Rated operating voltage (Un):

24 Vac/dc; 50...60 Hz 120 Vac; 50...60 Hz 230 Vac; 50...60 Hz < 10 VA

Rated power consumption AC: Rated power consumption DC: Max switching voltage:

230 Vac 6 A C300

< 5 W

Max switching current per contact: Utilization category

- Notes:

   Use 60° or 75 °C copper (Cu) conductor and wire size No. 30-12 AWG.


   Terminal tightening torque of 5-7 Lb In.

   Only for 24 Vac/dc version, supply from remote class 2 source or limited voltage and limited energy.


   Surrounding air of 55 °C.

# Safety module CS AT-0

#### **Terminals layout**




# Internal wiring diagram

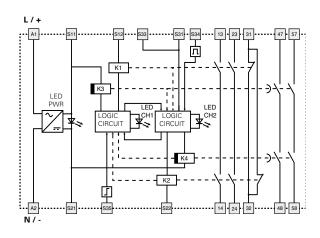


# **Operation diagrams**


Configuration with automatic start



Configuration with monitored start



Configuration with manual start



Legend:

 $\mathbf{t}_{\text{MIN}}$ : Min. period of start impulse  $\mathbf{t}_{\mathbf{c}}$ : Simultaneity time

t<sub>c</sub>: Simultaneity timet<sub>A</sub>: Operating timet<sub>B1</sub>: Releasing time


t<sub>R</sub>: Releasing time in absence of power supply

t<sub>R2</sub>: Adjustable releasing time delayed contacts (see "Code structure")

#### Note

The configurations with one channel are obtained taking into consideration only the S11/S12 input. In this case it is necessary to consider the  $\mathbf{t_{n1}}$  and  $\mathbf{t_{n2}}$  time referred to S11/S12 input, the  $\mathbf{t_{n}}$  time referred to the supply, the  $\mathbf{t_{\lambda}}$  time referred to S11/S12 input and to the start, and the  $\mathbf{t_{m1}}$  time referred to the start.

# Inputs configuration

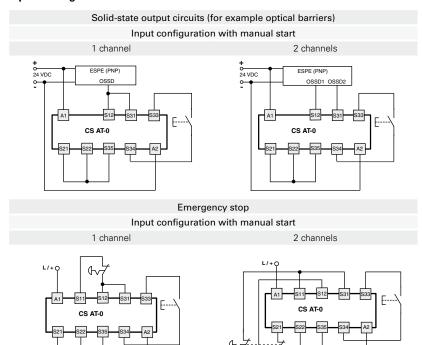


# Automatic start

As regards the indicated diagrams, in order to activate the module with the automatic start, it is necessary to short the start button between S33 and S34 terminals.



# Monitored start


As regards the indicated diagrams, in order to activate the module with the monitored start, it is necessary to remove the connection between S22 and S35 terminals.



# Gate monitoring and safety magnetic sensors

The safety module can control both emergency stop circuits, gate monitoring circuits or safety magnetic sensors. Replace the emergency stop contacts with switches contacts or with the sensors contacts.

The sensors can only be used in the 2-channel configuration.



Application example See page 5/79



Module, with delayed contacts at the opening of the input channels, for emergency stop, gate monitoring, solid state output devices and magnetic safety sensor

#### Main functions

- For safety applications up to SIL 3 / PL e
- Single or dual channel input circuit
- Choice between automatic start, manual start or monitored start
- Connection of the input channels to opposite potentials
- Connectible to Solid-state output circuits (for example optical barriers), to electromechanical contacts or to magnetic safety sensor
- 45 mm housing
- 3 NO safety instantaneous contacts, 2 NO safety delayed contacts.
- Supply voltages: 24 Vac/dc, 120 Vac, 230 Vac

**Utilization categories** Alternate current: AC15 (50...60 Hz) Ue (V) le (A)

Direct current: DC13 (6 operations/minute) Ue (V) le (A)

Markings, quality marks and certificates:



Approval UL: E131787

Complying with the requirements requested by:

Low Voltage Directive 2006/95/EC, Machinery Directive 2006/42/EC

Electromagnetic Compatibility 2004/108/EC

#### **Technical data**

### Housing

Made of polyamide PA 6.6 self-extinguishing, class V0 (UL94)

IP40 (housing), IP20 (terminals) Protection degree: Dimensions: see page 5/82, shape C

#### General data

Safety parameters:

Ambient temperature:

SIL level (SIL CL): up to SIL 3 according to EN IEC 62061 Performance Level (PL): up to PL e according to EN ISO 13849-1 Safety category: up to category 4 (instantaneous contacts) category 3 (delayed contacts)

according to EN 954-1 see page 7/32 -25°C...+55°C

>10 millions of operations Mechanical endurance: >100.000 operations Electrical endurance: Pollution degree: outside 3, inside 2

Rated impulse with stand voltage (Uimp): 4 KV Rated insulation voltage (Ui): 250 V Over-voltage category: 0,5 Kg Weight:

### Power supply

24 Vac/dc; 50...60 Hz Rated operating voltage (Un): 120 Vac; 50...60 Hz

230 Vac: 50...60 Hz

Max residual ripple in DC: 10% ±15% of Un Supply voltage tolerance: Rated power consumption AC: < 10 VA Rated power consumption DC: < 5 W

#### **Control circuit**

Protection against short circuits: resistance PTC, Ih=0,5 A intervention > 100 ms, reset > 3 s Operating time of PTC:

Max input resistance: ≤ 50 Ω Current for each input: 30 mA Min. period of start impulse t<sub>MIN</sub>: 200 ms Operating time t<sub>a</sub>: 150 ms Releasing time t<sub>R1</sub>: 20 ms Releasing time in absence of power supply ta: 150 ms

Releasing time delayed contacts t<sub>R2</sub>: see "CODE STRUCTURE"

Simultaneity time t<sub>c</sub>: infinite

# In conformity with standards:

IEC 60947-1, EN 60947-5-1, IEC 60204-1, EN 60204-1, EN ISO 13849-1, EN 999, EN 1037, EN ISO 12100-1, EN ISO 12100-2, EN ISO 13850, IEC 529, EN 60529, EN 61000-6-2, EN 61000-6-3, EN 62326-1, EN 60664-1, EN 60947-5-1, EN 62061, EN 13849-1, UL 508, CSA C22.2 n° 14-95

# **Output circuit**

Output contacts: 3 NO safety instantaneous contacts, 2 NO safety delayed contacts.

Contacts type: forced guided contacts silver alloy, gold plated Contacts material: Max switching voltage: 230/240 Vac; 300 Vdc Max switching current per contact: 6 A

Conventional free air thermal current lth: 6 A

Max currents sum  $\Sigma$  Ith<sup>2</sup>: 72 (instantaneous cont.), 36 (delayed cont.)  $A^2$ 

Min. current: 10 mA Contacts resistance: ≤ 100 mΩ Contact protection fuse: 6 A, F type

The number and the load capacity of output contacts can be increased by using expansion modules or contactors See page See page 5/49 - 5/58 and 5/79

#### **Code structure**

# CS AT-10V024-TF1

# Releasing time delayed contacts (t<sub>R2</sub>)

- Fixed time (see TF)
- from 0,3 to 3 s, step 0,3 s 1
- from 1 to 10 s, step 1 s
- from 3 to 30 s, step 3 s
- 4 from 30 to 300 s, step 30 s

#### Kind of connection

- screw terminals
- connector with screw terminals connector with spring terminals

# Releasing time delayed contacts (t<sub>R2</sub>)

**TF0.5** fixed 0,5 s **TF1** fixed 1 s

TF3 fixed 3 s

#### Supply voltage

024	24 Vac/dc	±15%
120	120 Vac	±15%
230	230 Vac	±15%

# Data type approved by UL

24 Vac/dc; 50...60 Hz Rated operating voltage (Un): 120 Vac; 50...60 Hz 230 Vac; 50...60 Hz < 10 VA Rated power consumption AC: Rated power consumption DC: < 5 W 230 Vac Max switching voltage: Max switching current per contact: 6 A C300 Utilization category

- Note:

   Use 60° or 75°C copper (Cu) conductor and wire size No. 30-12 AWG.


   Terminal tightening torque of 5-7 Lb In.

   Only for 24 Vac/dc version, supply from remote class 2 source or limited voltage and limited energy.


   Surrounding air of 55°C.

# Safety module CS AT-1

#### **Terminals layout**




# Internal wiring diagram

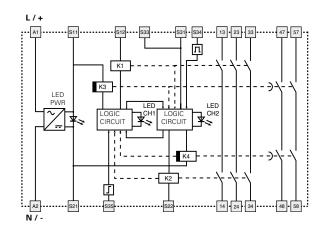


# **Operation diagrams**


Configuration with automatic start



Configuration with monitored start



Configuration with manual start



Legend:

 $\mathbf{t}_{\mathbf{min}}$ : Min. period of start impulse  $\mathbf{t}_{\mathbf{c}}$ : Simultaneity time


t<sub>A</sub>: Operating time Releasing time

Releasing time in absence of power supply

Adjustable releasing time delayed contacts (see "Code structure")

The configurations with one channel are obtained taking into consideration only the S11/S12 input. In this case it is necessary to consider the  $\mathbf{t_{R1}}$  and  $\mathbf{t_{R2}}$  time referred to S11/S12 input, the  $\mathbf{t_{R}}$  time referred to the supply, the  $\mathbf{t_{A}}$  time referred to S11/S12 input and to the start, and the  $\mathbf{t_{MIN}}$  time referred to the start.

#### Inputs configuration

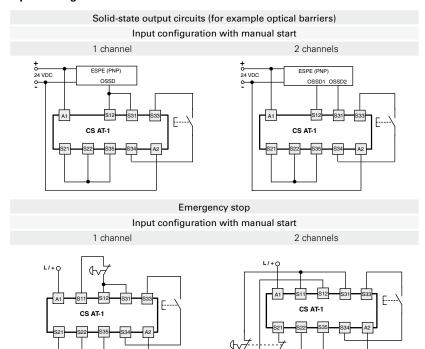


#### Automatic start

As regards the indicated diagrams, in order to activate the module with the automatic start, it is necessary to short the start button between S33 and S34 terminals.



#### Monitored start


As regards the indicated diagrams, in order to activate the module with the monitored start, it is necessary to remove the connection between S22 and S35 terminals.



# Gate monitoring and safety magnetic sensors.

The safety module can control both emergency stop circuits, monitoring circuits or safety magnetic sensors. Replace the emergency stop contacts with switches contacts or with the sensors contacts.

The sensors can only be used in the 2-channel configuration.



Application example See page 5/79

ĠΝ/-



Module for emergency stop and gate monitoring and magnetic safety sensor with delayed contacts at the opening of the input channels

#### Main functions

- For safety applications up to SIL 3 / PL e
- Single or dual channel input circuit
- Choice between automatic start, manual start or monitored start
- Connectible to electromechanical contacts or to magnetic safety sensor
- 22,5 mm housing
- 2 NO safety instantaneous contacts, 1 NO safety delayed contact.
- Supply voltages: 24 Vac/dc

# **Utilization categories**

Alternate current: AC15 (50...60 Hz) Ue (V) 230 le (A) 3

Direct current: DC13 (6 operations/minute)

Ue (V) le (A)

# Markings, quality marks and certificates:





Approval UL:

# Complying with the requirements requested by:

Low Voltage Directive 2006/95/EC, Machinery Directive 2006/42/EC,

Electromagnetic Compatibility 2004/108/EC

#### **Technical data**

# Housing

Made of polyamide PA 6.6 self-extinguishing, class V0 (UL94)

IP40 (housing), IP20 (terminals) Protection degree: Dimensions: see page 5/82, shape C

### General data

SIL level (SIL CL): up to SIL 3 according to EN IEC 62061 Performance Level (PL): up to PL e according to EN ISO 13849-1 up to category 4 (instantaneous contacts) Safety category: category 3 (delayed contacts)

according to EN 954-1

Safety parameters: see page 7/32 Ambient temperature: -25°C...+55°C

>10 millions of operations Mechanical endurance: Electrical endurance: >100.000 operations Pollution dearee: outside 3, inside 2 4 KV

Rated impulse with stand voltage (Uimp): Rated insulation voltage (Ui): 250 V Over-voltage category: Weight: 0.3 Ka

#### **Power supply**

Rated operating voltage (Un): 24 Vac/dc; 50...60 Hz

Max residual ripple in DC: 10% ±15% of Un Supply voltage tolerance: Rated power consumption AC: < 10 VA Rated power consumption DC: < 5 W

#### Control circuit

Protection against short circuits: resistance PTC, Ih=0,5 A

intervention > 100 ms, reset > 3 s Operating time of PTC:

Max input resistance: ≤ 50 Ω Current for each input: 30 mA Min. period of start impulse  $t_{MIN}$ : 100 ms Operating time t<sub>a</sub>: 70 ms Releasing time  $t_{\rm R1}$ : 15 ms Releasing time in absence of power supply to: 100 ms

Releasing time delayed contacts  $t_{R2}$ : see "Code structure"

Simultaneity time t<sub>c</sub>: infinite

# In conformity with standards:

IEC 60947-1, EN 60947-5-1, IEC 60204-1, EN 60204-1, EN ISO 13849-1, EN 999, EN 1037, EN ISO 12100-1, EN ISO 12100-2, EN ISO 13850, IEC 529, EN 60529, EN 61000-6-2, EN 61000-6-3, EN 62326-1, EN 60664-1, EN 60947-5-1, EN 62061, EN 13849-1, UL 508, CSA C22.2 n° 14-95

# **Output circuit**

Output contacts: 2 NO safety instantaneous contacts, 1 NO safety delayed contact.

Contacts type: forced guided contacts Contacts material: silver alloy, gold plated Max switching voltage: 230/240 Vac; 300 Vdc

Max switching current per contact: 6 A Conventional free air thermal current lth: 6 A Max currents sum  $\Sigma$  Ith<sup>2</sup>: 36 A<sup>2</sup> Min. current: 10 mA ≤ 100 mΩ Contacts resistance: Contact protection fuse: 6 A, F type

The number and the load capacity of output contacts can be increased by using expansion modules or contactors See page See page 5/49 - 5/58 and 5/79

# **Code structure**

# CS AT-30V024-TF1

# Releasing time delayed contacts (t<sub>so</sub>)

- 0 Fixed time (see TF)
- 1 from 0,3 to 3 s, step 0,3 s
- from 1 to 10 s, step 1 s 2
- from 3 to 30 s, step 3 s
- from 30 to 300 s, step 30 s

# Kind of connection

- screw terminals
- connector with screw terminals
- **X** connector with spring terminals

#### Releasing time delayed contacts (t<sub>R2</sub>)

**TF0.5** fixed 0.5 s

TF1 fixed 1 s

TF3 fixed 3 s

# Supply voltage

**024** 24 Vac/dc ±15%

# Data type approved by UL

24 Vac/dc; 50...60 Hz Rated operating voltage (Un): Rated power consumption AC < 10 VA Rated power consumption DC: < 5 W Max switching voltage: 230 Vac Max switching current per contact: 6 A

Utilization category

C300

Notes:

- Use 60° or 75 °C copper (Cu) conductor and wire size No. 30-12 AWG.

- Terminal tightening torque of 5-7 Lb In.


- Only for 24 Vac/dc version, supply from remote class 2 source or limited voltage and limited energy.

- Surrounding air of 55 °C.


# 5C

# Safety module CS AT-3

#### **Terminals layout**




# Internal wiring diagram

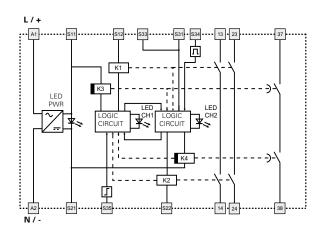


# **Operation diagrams**


Configuration with automatic start



Configuration with monitored start



Configuration with manual start



Legend:

t<sub>MIN</sub>: Min. period of start impulse
t<sub>c</sub>: Simultaneity time

t<sub>A</sub>: Operating time Releasing time


Releasing time in absence of power supply


Adjustable releasing time delayed contacts (see "Code structure")

The configurations with one channel are obtained taking into consideration only the S11/S12 input. In this case it is necessary to consider the  $\mathbf{t}_{n_1}$  and  $\mathbf{t}_{n_2}$  times referred to S11/S12 input, the  $\mathbf{t}_{n_1}$  time referred to the supply, the  $\mathbf{t}_{n_1}$  time referred to S11/S12 input and to the start, and the  $\mathbf{t}_{min}$  time referred to the start.

# Inputs configuration

•		
Emergency stop		
Input configuration with manual start		
1 channel	2 channels	





The diagram does not show the exact position of clamps in the product


# Automatic start

As regards the indicated diagrams, in order to activate the module with the automatic start, it is necessary to short the start button between S33 and S34 terminals.



# Monitored start


As regards the indicated diagrams, in order to S21 activate the module with the monitored start, it is necessary to remove the connection between S22 and S35 terminals.



# Gate monitoring and safety magnetic sensors.

The safety module can control both emergency stop circuits, gate monitoring circuits or safety magnetic sensors. Replace the emergency stop contacts with switches contacts or with the sensors The contacts. sensors can only be used in the 2-channel configuration.





Application example See page 5/79

The diagram does not show the exact position of clamps in the product