

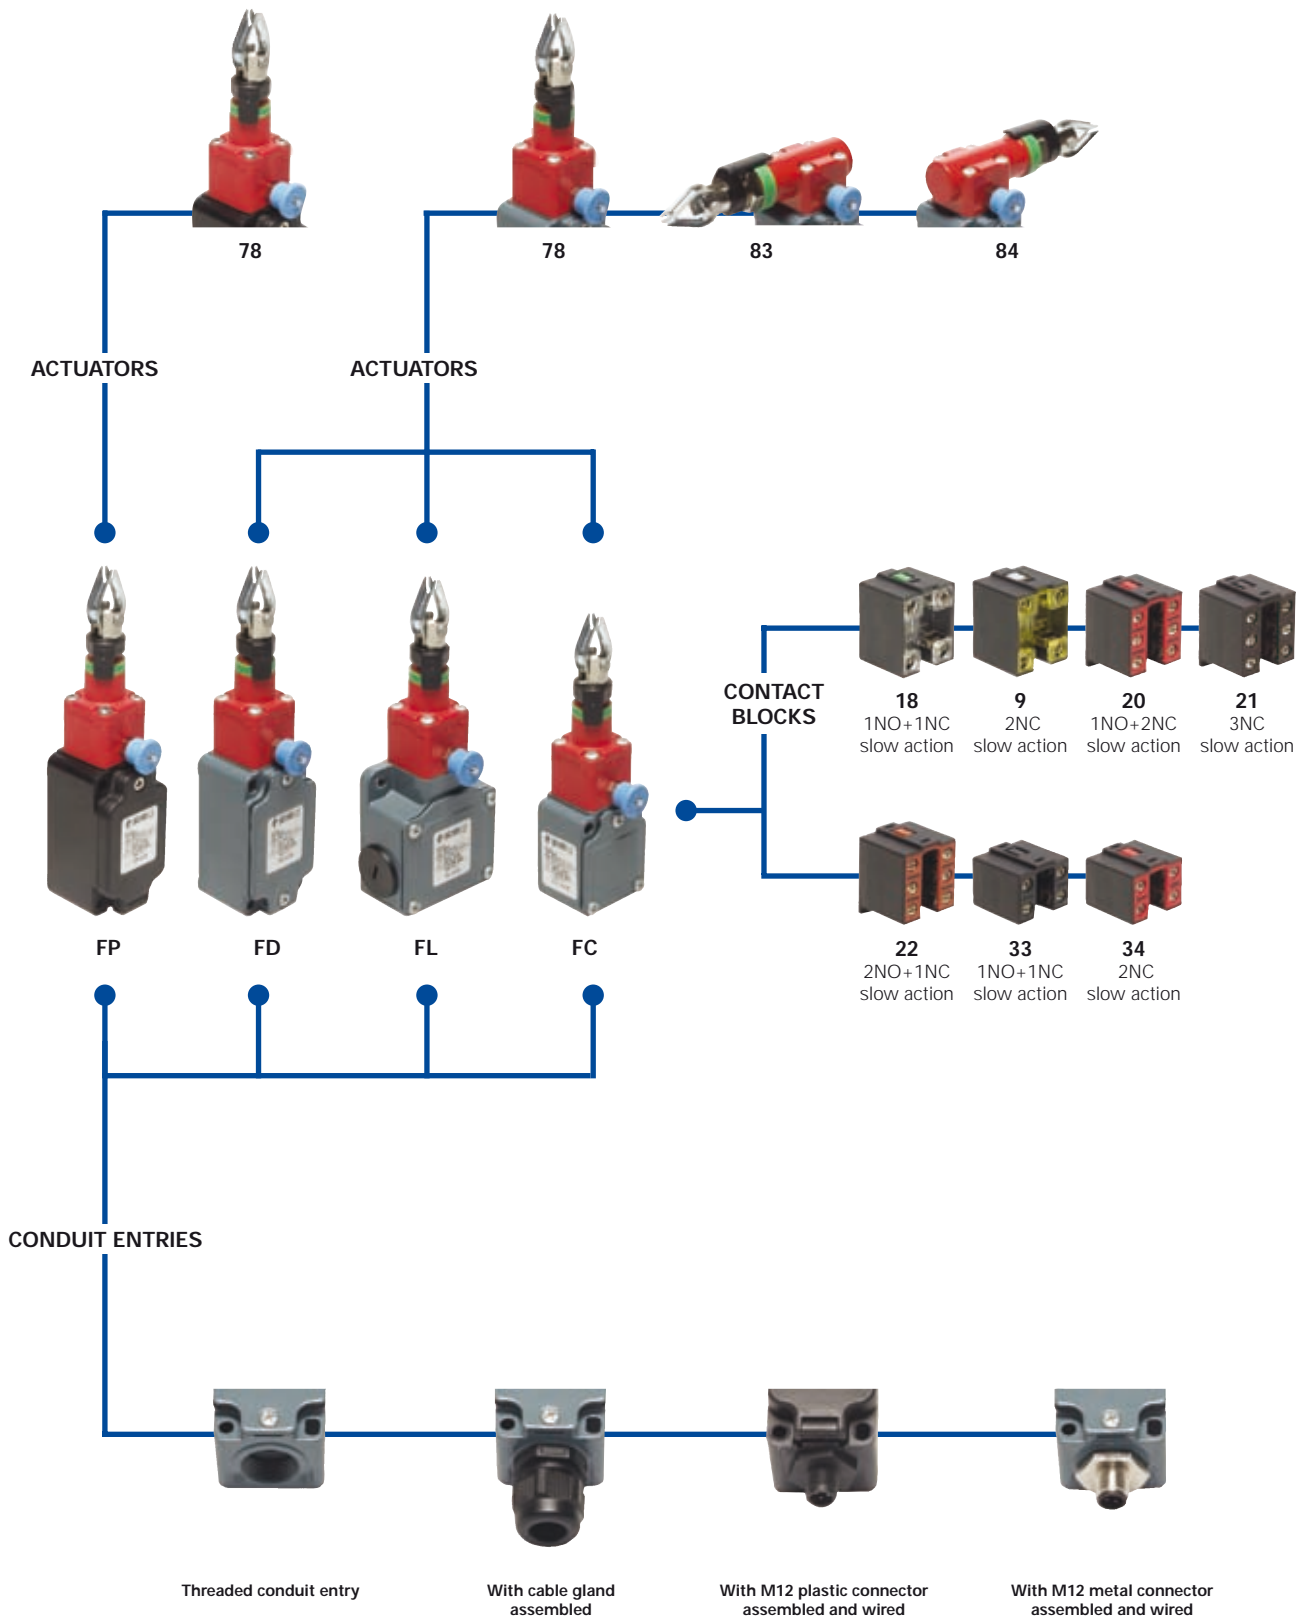


Selection diagram

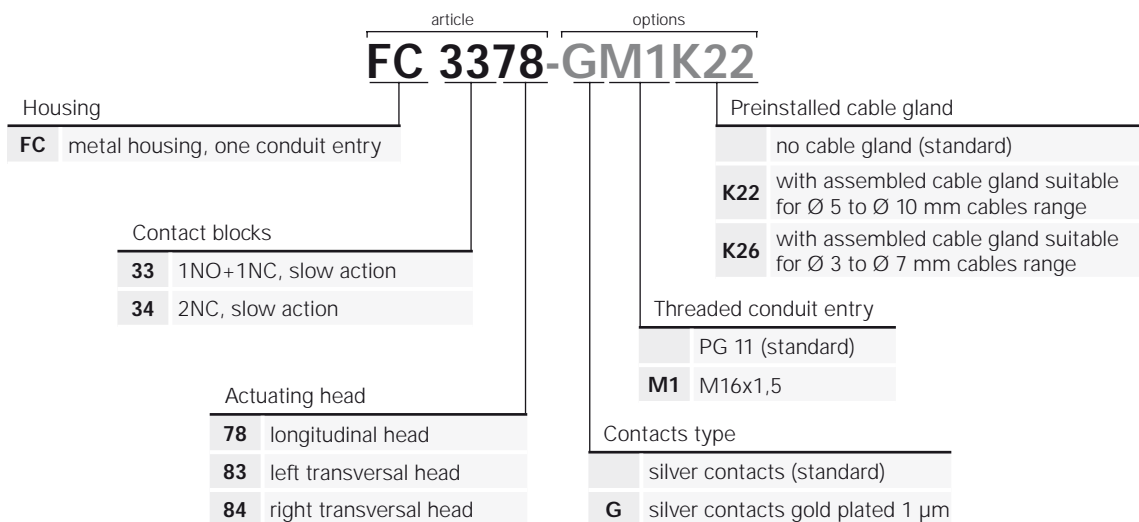

Code structure

Attention! The feasibility of a code number does not mean the effective availability of a product. Please contact our sales office.

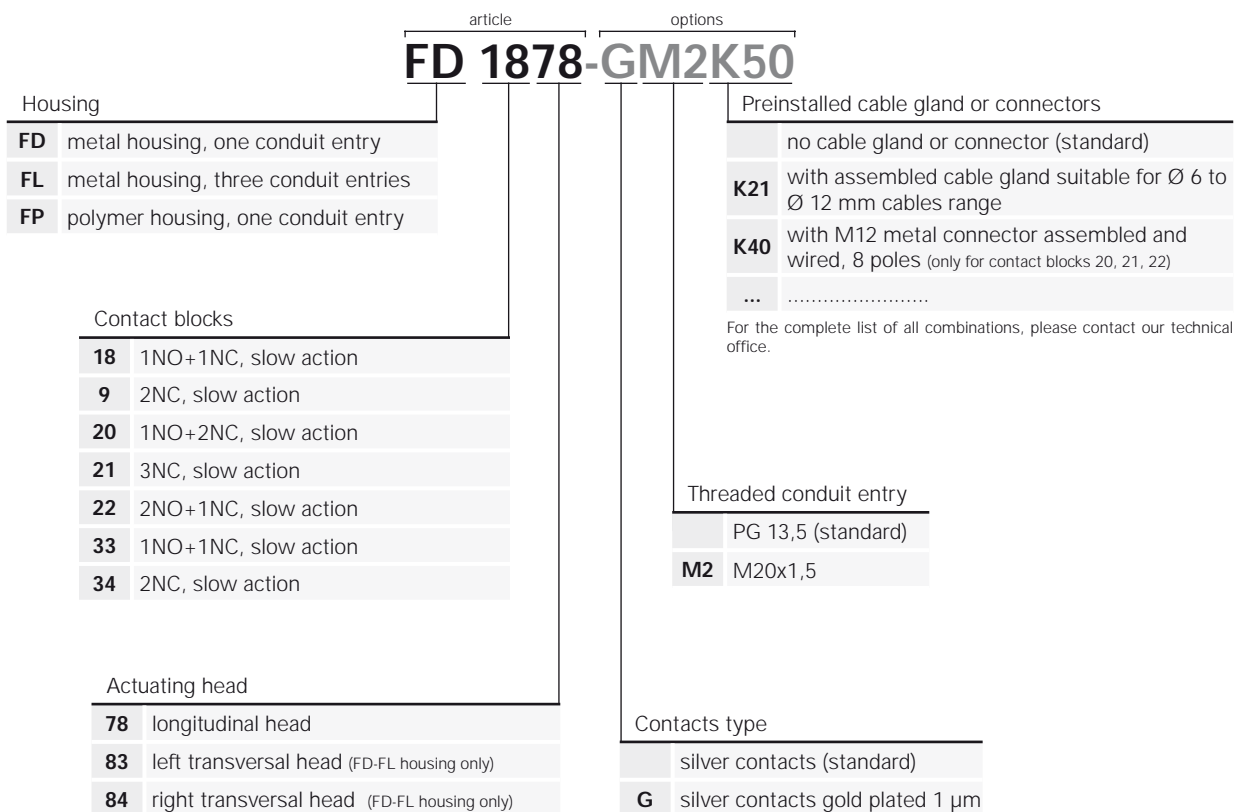



Main data

- Metal or polymer housing, from one to three conduit entries
- Protection degree IP67
- In conformity with EN ISO 13850
- 7 contact blocks available
- Transversal head or longitudinal head versions
- M12 assembled connector versions
- Silver contacts gold plated versions
- Several accessories available

Markings and quality marks:



Approval IMQ:	EG605 (FD-FLFC series) EG606 (FP series)
Approval UL:	E131787
Approval CCC:	2007010305230000 (FD-FLFC series) 2007010305230014 (FP series)
Approval ECU:	1010151

Technical data

Housing

Housing type FP made of glass-reinforced polymer, self-extinguishing, shock-proof thermoplastic resin with double insulation □

Housing type FD and FC made of metal, coated with baked epoxy powder.

FD, FP and FC series one conduit entry

FL series three conduit entries

Protection degree: IP67

General data

Ambient temperature: from -25°C to +80°C

Version for operation in ambient temperature from -40°C to +80°C on request

Max operating frequency: 1 operation cycles / 6 s

Mechanical endurance: 1 million of operations cycles¹

Max actuating speed: 0,5 m/s

Min. actuating speed: 1 mm/s

(1) One operation cycle means two movements, one to close and one to open contacts, as foreseen by IEC 947-5-1 standard.

Cross section of the conductors (flexible copper wire)

Contact blocks 20, 21, 22, 33, 34:	min.	1 x 0,34 mm ²	(1 x AWG 22)
	max.	2 x 1,5 mm ²	(2 x AWG 16)
Contact blocks 18, 9:	min.	1 x 0,5 mm ²	(1 x AWG 20)
	max.	2 x 2,5 mm ²	(2 x AWG 14)

In conformity with standards:

IEC 60947-5-1, EN 60947-5-1, IEC 60204-1, EN 60204-1, EN 1088, EN ISO 12100-1, EN ISO 12100-2, IEC 529, EN 60529, EN ISO 13850, EN 418, NFC 63-140, VDE 0660-200, VDE 0113, CENELEC EN 50013.

Approvals:

IEC 60947-5-1, UL 508, GB14048.5-2001

In conformity with requirements requested by:

Low Voltage Directive 2006/95/EC, Machinery Directive 2006/42/EC and Electromagnetic Compatibility 2004/108/EC.

Positive contact opening in conformity with standards:

IEC 60947-5-1, EN 60947-5-1, VDE 0660-206.

⚠ If not expressly indicated in this chapter, for the right installation and the correct utilization of all articles see requirements indicated from page 6/1 to page 6/8.

Electrical data

Utilization categories

without connector	Thermal current (I _{th}):	10 A	Alternate current: AC15 (50...60 Hz)			
	Rated insulation voltage (U _i):	500 VAC 600 VDC	U _e (V)	250	400	500
		400 VAC for contact blocks 20, 21, 22, 33, 34	I _e (A)	6	4	1
	Protection against short circuits:	fuse 10 A 500 V type aM	Direct current: DC13			
	Pollution degrees:	3	U _e (V)	24	125	250
			I _e (A)	6	1,1	0,4

with 4 or 5 poles M12 connector	Thermal current (I _{th}):	4 A	Alternate current: AC15 (50...60 Hz)			
	Rated insulation voltage (U _i):	250 VAC 300 VDC	U _e (V)	24	120	250
	Protection against short circuits:	fuse 4 A 500 V type gG	I _e (A)	4	4	4
	Pollution degrees:	3	Direct current: DC13			
			U _e (V)	24	125	250
			I _e (A)	4	1,1	0,4

with 8 poles M12 connector	Thermal current (I _{th}):	2 A	Alternate current: AC15 (50...60 Hz)			
	Rated insulation voltage (U _i):	30 VAC 36 VDC	U _e (V)	24		
	Protection against short circuits:	fuse 2 A 500 V type gG	I _e (A)	2		
	Pollution degrees:	3	Direct current: DC13			
			U _e (V)	24		
			I _e (A)	2		

Description


These rope operated safety switches are installed on machines or conveyor belts, to activate the emergency stop of the machine on every hand intervention on the rope, from any point. They allow cost savings on machines of medium-large size, where normally many emergency stop push buttons can be replaced by one single switch. Provided with **self-control function**, they constantly check their correct working operation, signalling with the opening of the contacts an eventual loosening or breaking of the rope. These safety switches, after their activation, keep the contacts open till the reset push button is manually pulled, even if the rope is left free.

Rotating heads



Removing the four fastening screws, in all switches, it is possible to rotate the head in 90° steps.

Rope regulation point indicator

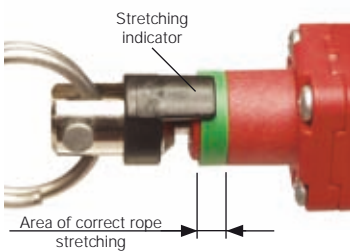

All switches are provided with a green ring that shows the area of the correct stretching of the rope. The installer has only to stretch the rope until the black indicator will be in the middle of the green area. In this position it is possible to reset the switch, pulling the reset button, and to close the electrical safety contacts.

If a traction (or loosening) of the rope it is high enough to permit the black indicator to go outside the correct stretching area, there will be the reset action and the opening of the safety contacts.

Reset button indicator



If the rope stretching indicator is in the correct operation area, it is possible to close the electric safety contacts pulling the blue reset button. The green ring signal allows to know the switch condition quickly.

Extracts from Standards

EN 418 point 4.1.11

"Any action on the actuator that causes the intervention of the emergency stop signal must cause the mechanical block of the control device as well..."

EN 418 point 4.5.2 (requirements referring to ropes, when used as actuators)

"In case of break or disconnection of a rope, the emergency stop signal must be automatically generated"

Data type approved by IMQ, CCC and EZU

Rated insulation voltage (Ui): 500 VAC
400 VAC for contact blocks 20, 21, 22, 33, 34

Thermal current (Ith): 10 A

Protection against short circuits: fuse 10 A 500 V type aM

Protection degree: IP67

MV terminals (screw clamps)

Pollution degrees 3

Utilization category: AC15

Operation voltage (Ue): 400 VAC (50 Hz)

Operation current (Ie): 3 A

Forms of the contact element: Zb, Y+Y, Y+Y+X, Y+Y+Y, Y+X+X

Positive opening of contacts on contact block 18, 9, 20, 21, 22, 33, 34

In conformity with standards: EN60947-1, EN 60947-5-1 and subsequent modifications and completions, fundamental requirements of the Low Voltage Directive 73/23 EEC and subsequent modifications and completions.

Data type approved by UL

Utilization categories Q300 (69 VA, 125-250 VDC)
A600 (720 VA, 120-600 VAC)

Data of the housing type 1, 4X (indoor use only), 12, 13

In conformity with standard: UL 508

For all contact blocks use 60 or 75 °C copper (Cu) conductor and wire size No. 12-14 AWG. Terminal tightening torque of 7,1 Lb-In.





Please contact our technical service for the list of type approved products.

Please contact our technical service for the list of type approved products.

Dimensional drawings




Contacts type:

= slow action

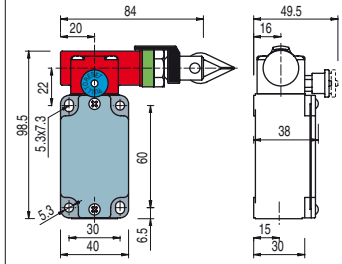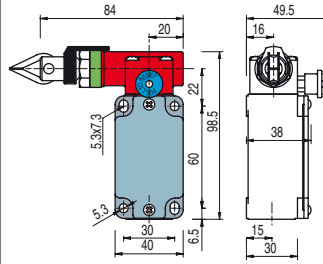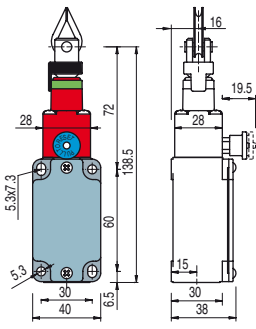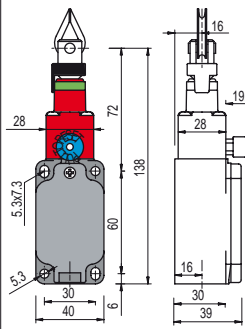

Contact blocks




18		FP 1878		1NO+1NC	FD 1878		1NO+1NC	FD 1883		1NO+1NC	FD 1884		1NO+1NC
9		FP 978		2NC	FD 978		2NC	FD 983		2NC	FD 984		2NC
20		FP 2078		1NO+2NC	FD 2078		1NO+2NC	FD 2083		1NO+2NC	FD 2084		1NO+2NC
21		FP 2178		3NC	FD 2178		3NC	FD 2183		3NC	FD 2184		3NC
22		FP 2278		2NO+1NC	FD 2278		2NO+1NC	FD 2283		2NO+1NC	FD 2284		2NO+1NC
33		FP 3378		1NO+1NC	FD 3378		1NO+1NC	FD 3383		1NO+1NC	FD 3384		1NO+1NC
34		FP 3478		2NC	FD 3478		2NC	FD 3483		2NC	FD 3484		2NC
Min. force		Initial 63 N...Final 83 N (90 N			Initial 63 N...Final 83 N (90 N			Initial 147 N...Final 235 N (250 N			Initial 147 N...Final 235 N (250 N		
Travel diagrams		page 4/84 - group 1			page 4/84 - group 1			page 4/84 - group 2			page 4/84 - group 2		

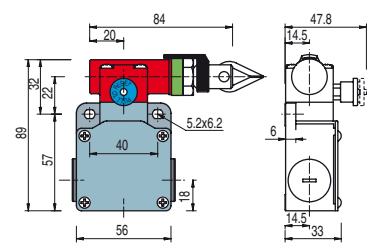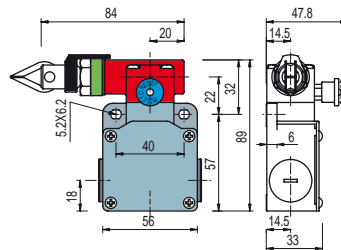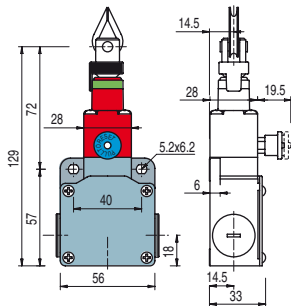

Contact blocks

18		FL 1878		1NO+1NC	FL 1883		1NO+1NC	FL 1884		1NO+1NC
9		FL 978		2NC	FL 983		2NC	FL 984		2NC
20		FL 2078		1NO+2NC	FL 2083		1NO+2NC	FL 2084		1NO+2NC
21		FL 2178		3NC	FL 2183		3NC	FL 2184		3NC
22		FL 2278		2NO+1NC	FL 2283		2NO+1NC	FL 2284		2NO+1NC
33		FL 3378		1NO+1NC	FL 3383		1NO+1NC	FL 3384		1NO+1NC
34		FL 3478		2NC	FL 3483		2NC	FL 3484		2NC
Min. force		Initial 63 N...Final 83 N (90 N			Initial 147 N...Final 235 N (250 N			Initial 147 N...Final 235 N (250 N		
Travel diagrams		page 4/84 - group 1			page 4/84 - group 2			page 4/84 - group 2		

Contacts type:
L = slow action

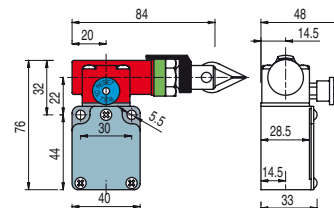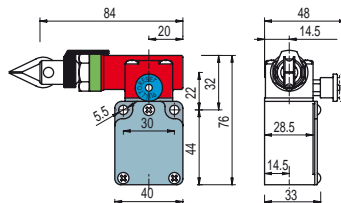


Contact blocks

33 L	FC 3378 ⊕ 1NO+1NC	FC 3383 ⊕ 1NO+1NC	FC 3384 ⊕ 1NO+1NC
34 L	FC 3478 ⊕ 2NC	FC 3483 ⊕ 2NC	FC 3484 ⊕ 2NC
Min. force	Initial 63 N ... Final 83 N (90 N ⊕)	Initial 147 N ... Final 235 N (250 N ⊕)	Initial 147 N ... Final 235 N (250 N ⊕)
Travel diagrams	page 4/84 - group 1	page 4/84 - group 2	page 4/84 - group 2

How to read travel diagrams

All measures in the diagrams are in mm

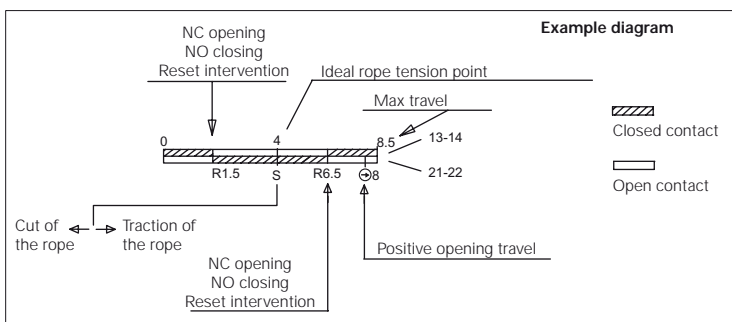


Travel diagrams table

Contact blocks	Group 1	Group 2
18 1NO+1NC 13 21 14 22		
9 2NC 11 21 12 22		
20 1NO+2NC 11 21 33 12 22 34		
21 3NC 11 21 31 12 22 32		
22 2NO+1NC 11 23 33 12 24 34		
33 1NC+1NO 13 21 14 22		
34 2NC 11 21 12 22		


IMPORTANT:

In safety applications it is necessary to activate the switch **at least up to the positive opening point** indicated in the diagrams with the symbol ⊕. Operate the switch **at least with the positive opening force**, indicated between brackets, below each article, next the value of minimum force.

Application examples and max rope length for switches with longitudinal heads

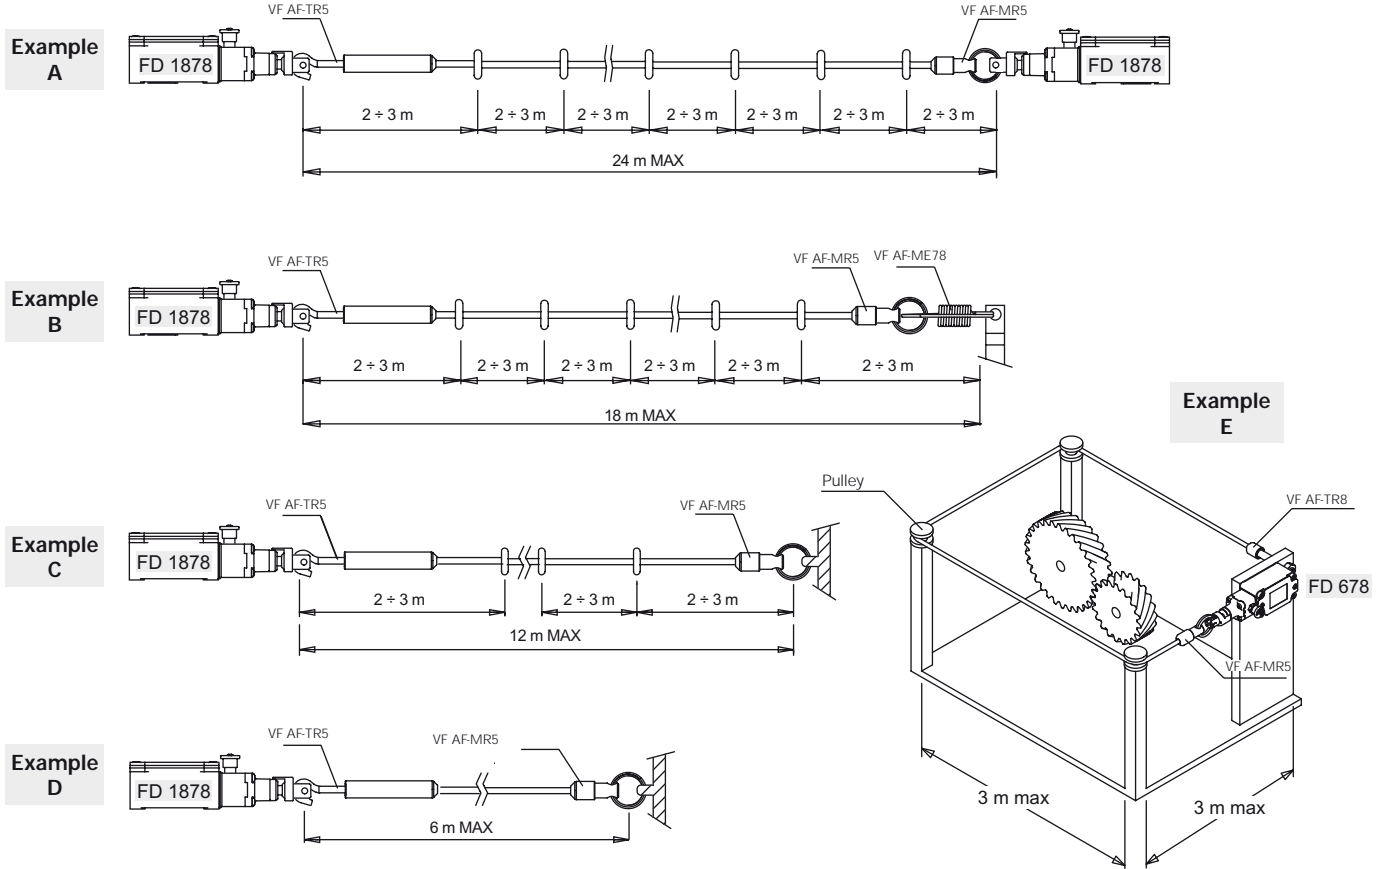


Application examples and max rope length for switches with transversal heads

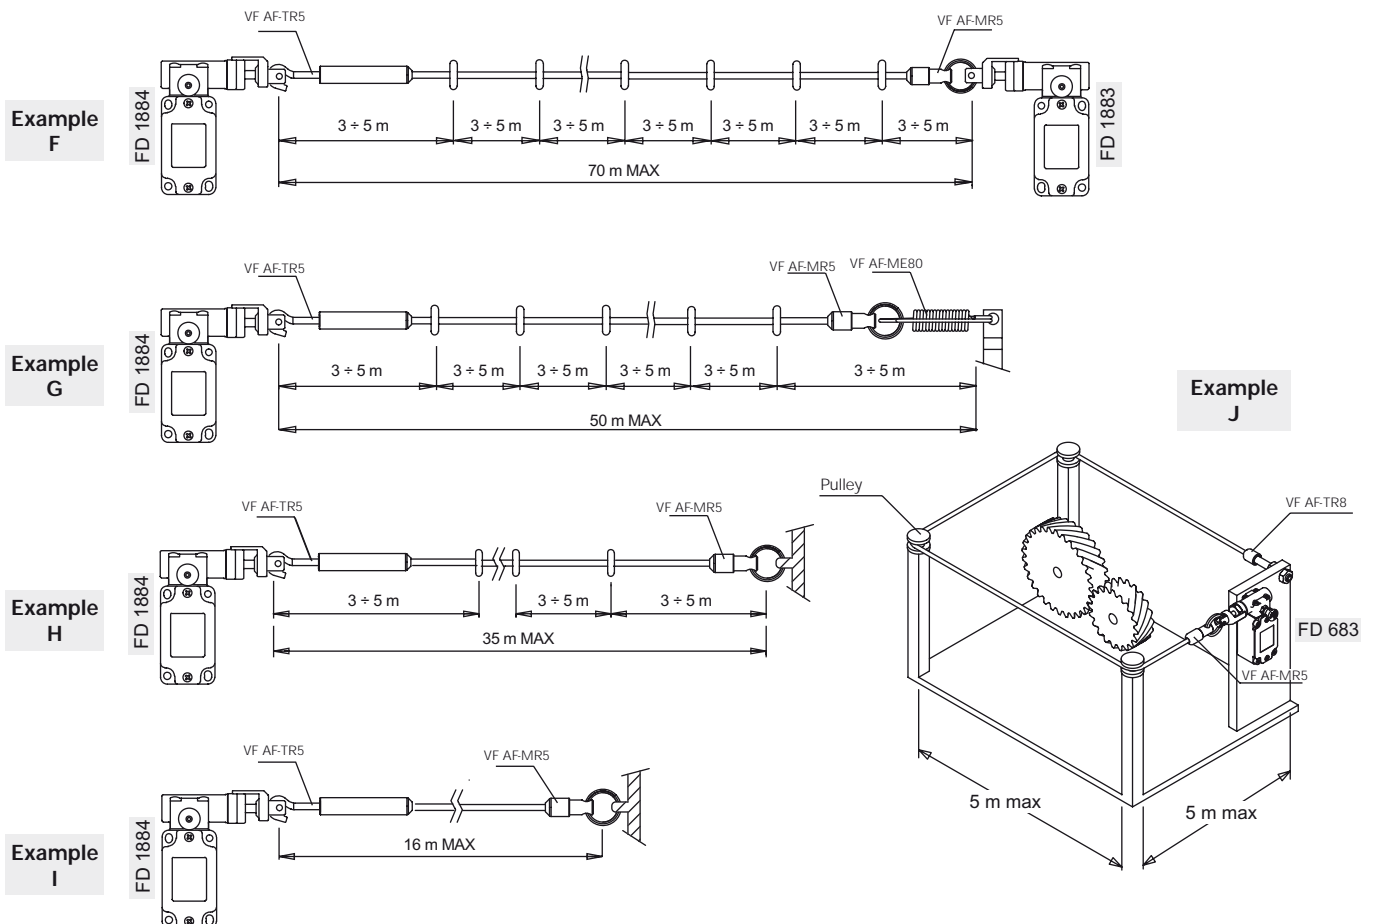


Max rope length

Max rope length for switches with longitudinal heads

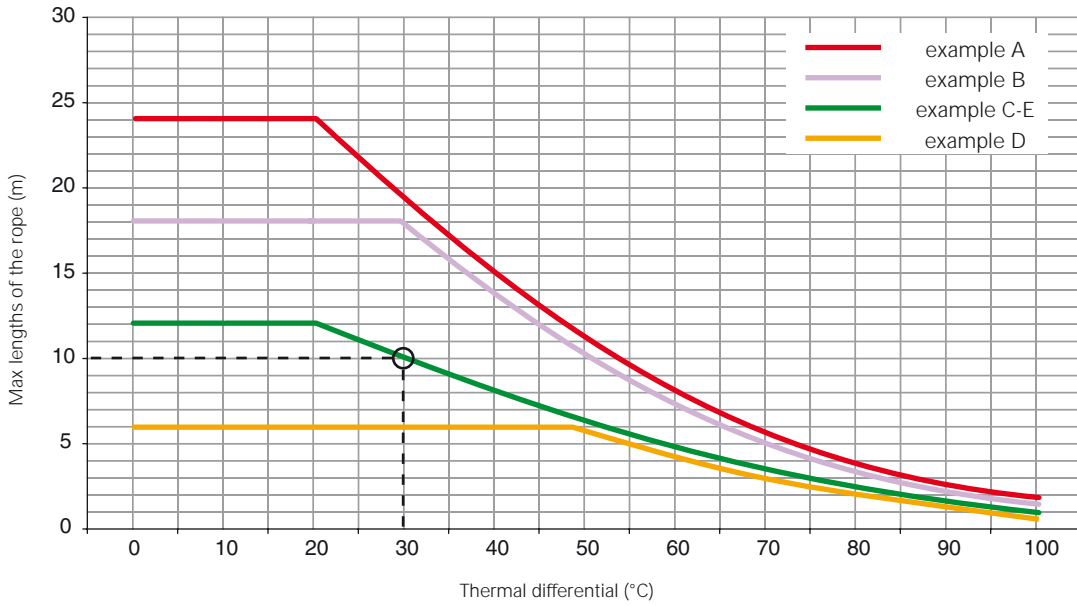


In the diagram, the suggested max. rope lengths with regard to changes of temperature (thermal differential) to which the switch is expected to be exposed in the working area are indicated. For instance, for an example C installation which expects a thermal differential of 30°C, a max rope length of 10 meters is suggested.

Max rope length for switches with transversal heads

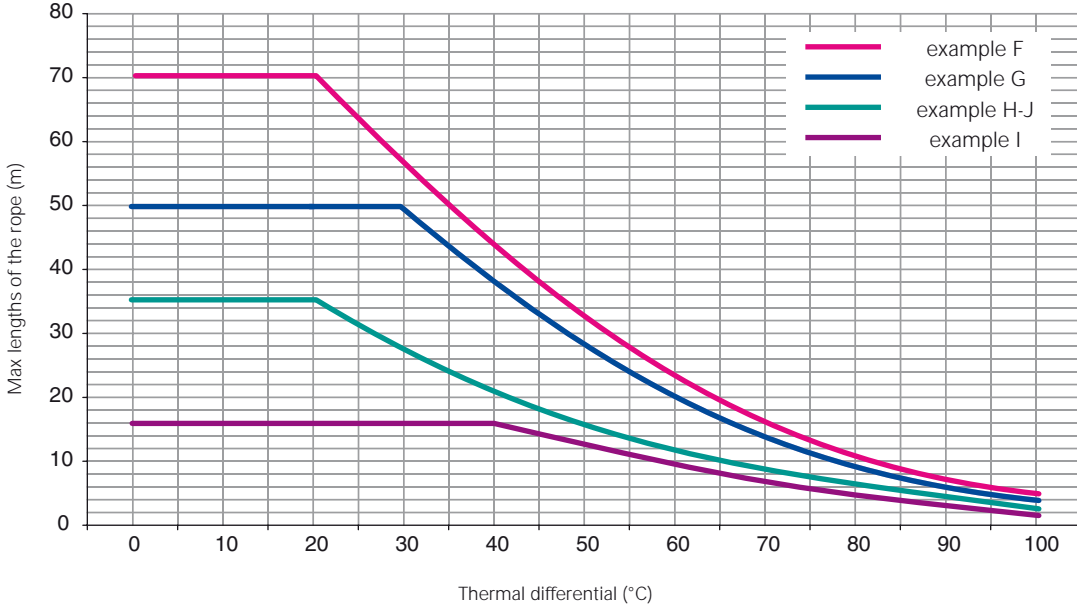


Important: The above data are guaranteed only using original rope and accessories. See page 4/83.

Regulation of intervention point

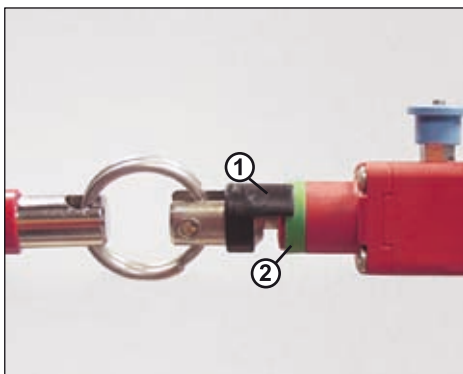

Stretch the rope connected to the switch, until the end of the indicator (1) reaches about the middle of the green ring (2).

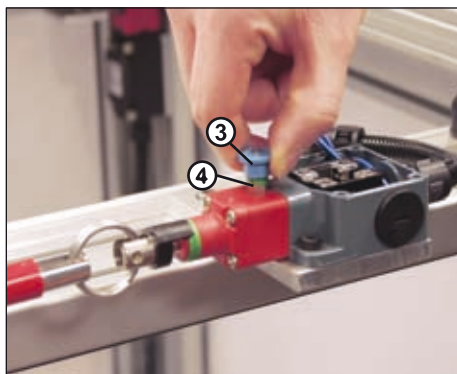

Pull the knob (3) in order to close the safety contacts inside the switch. Below the knob a green ring (4) will be disclosed.